
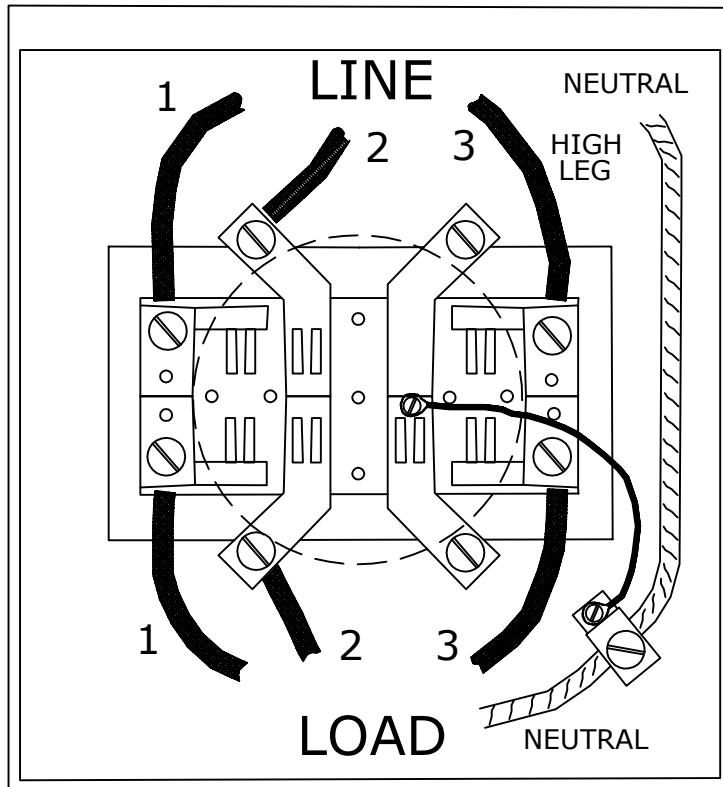


THREE-PHASE DELTA SELF CONTAINED METERING

- Meter base will be provided by the Member, Bypass Lever Type.
- Maximum 320 amp service. For larger services, transformer rated metering will be used (contact the Engineering Department).
- HIGH LEG must be marked with red or orange at the weatherhead, in the meter base, and in the main disconnect.

CONNECTIONS

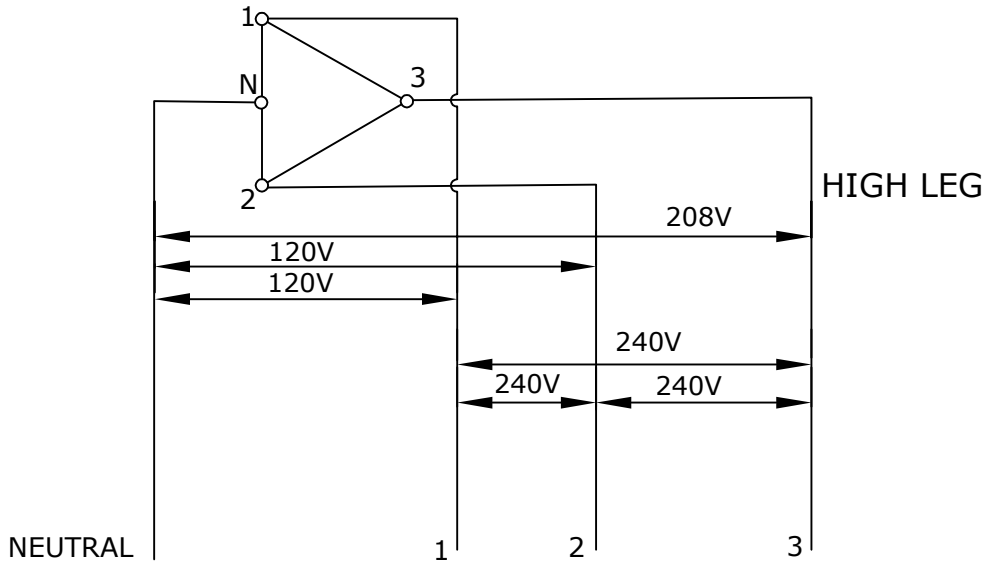

Revised 9/22/20 by BF

FIGURE 2